


BACKFLOW PREVENTION ASSEMBLY INSTALLATION GUIDE

DOUBLE CHECK VALVE ASSEMBLY (DCVA)

Vertical Installation

This insert serves as a guidance document for the installation of backflow prevention assemblies within the Charleston Water System (CWS) service area. All installations must be inspected and approved by CWS. Contact CWS within two days of installation to request an inspection. Inspection request line: 843-727-6981.

- Install assembly on customer's side of the water meter prior to any branch, tee or service connection.
- Install assembly in accordance with manufacturer's recommendations.
- Assemblies approved to be installed in the vertical orientation may be installed vertical with unobstructed access.
- Provide minimum 6" clearance on all sides of assembly.
- Installed assembly shall be easily accessible for in-line maintenance and testing.
- The centerline of the assembly shall not be installed higher than 54" from the floor.
- Provide copper, bronze, stainless steel, or ductile iron piping on inlet and outlet side of assembly.
- Black iron, black steel or galvanized steel pipe shall not be used in the upstream piping.
- Installed assembly shall be rigid and stable. CWS reserves the right to require additional support and restraint.
- CWS highly recommends freeze protection, such as insulated enclosures or padded wraps, for all above ground assemblies.
- For assemblies exposed to vehicular traffic, a traffic-grade enclosure box or protective bollards are recommended.

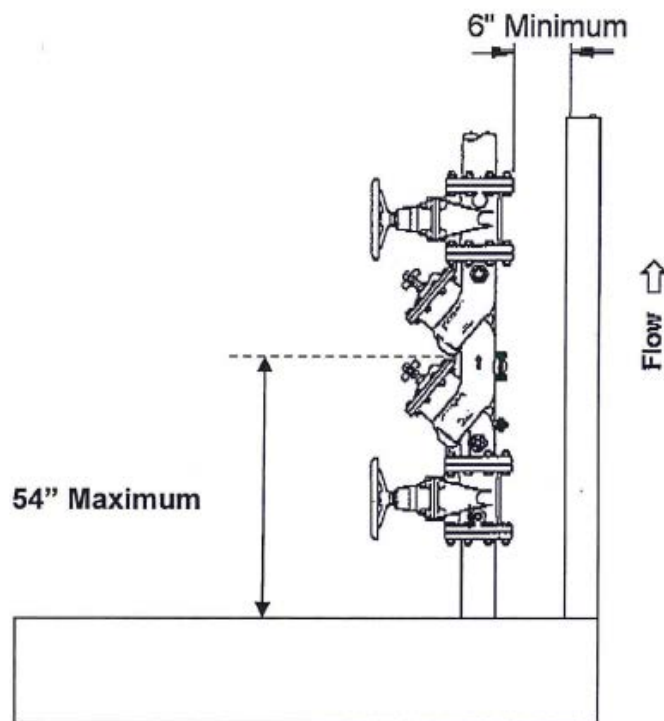

For questions concerning the installation, placement of your assembly or to request an inspection, contact CWS by phone at 843-727-6981, by fax at 843-579-6852, or by email at backflow@charlestoncpw.com. For additional information on CWS's Cross-Connection Control Program and a complete list of approved testers, please visit our website at www.charlestonwater.com.